


Supervision of Backflow Preventor

13D(2002) Reference 7.1.2


13R(2002) Reference 6.6.1.2

By: LT David Pazos

Old Watts Check Valve

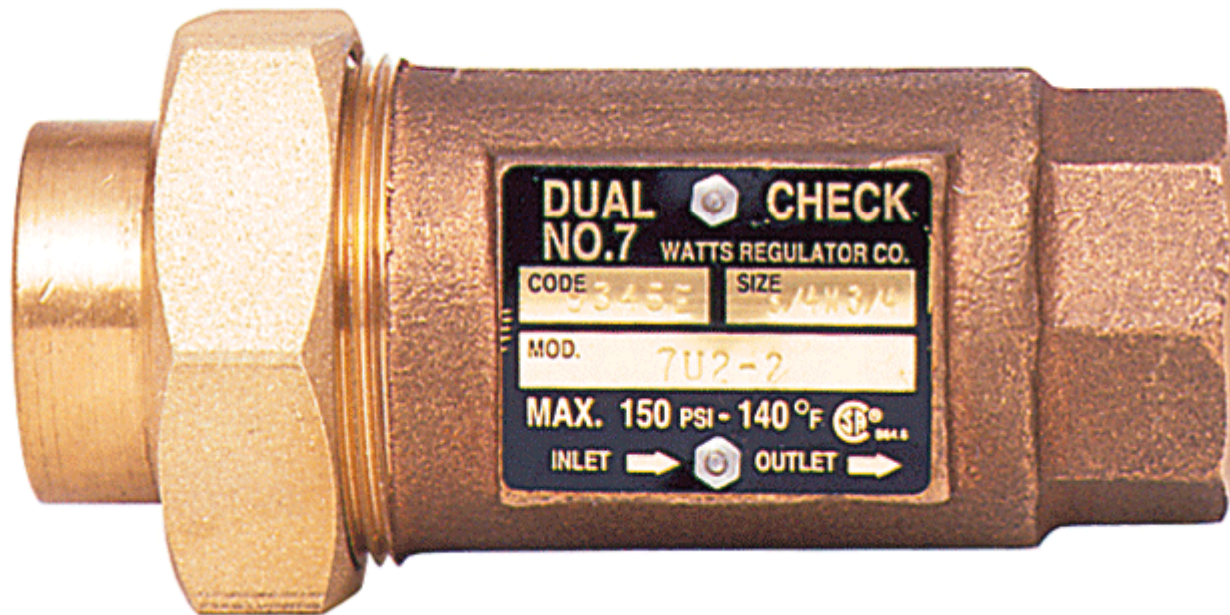

New Backflow Preventer

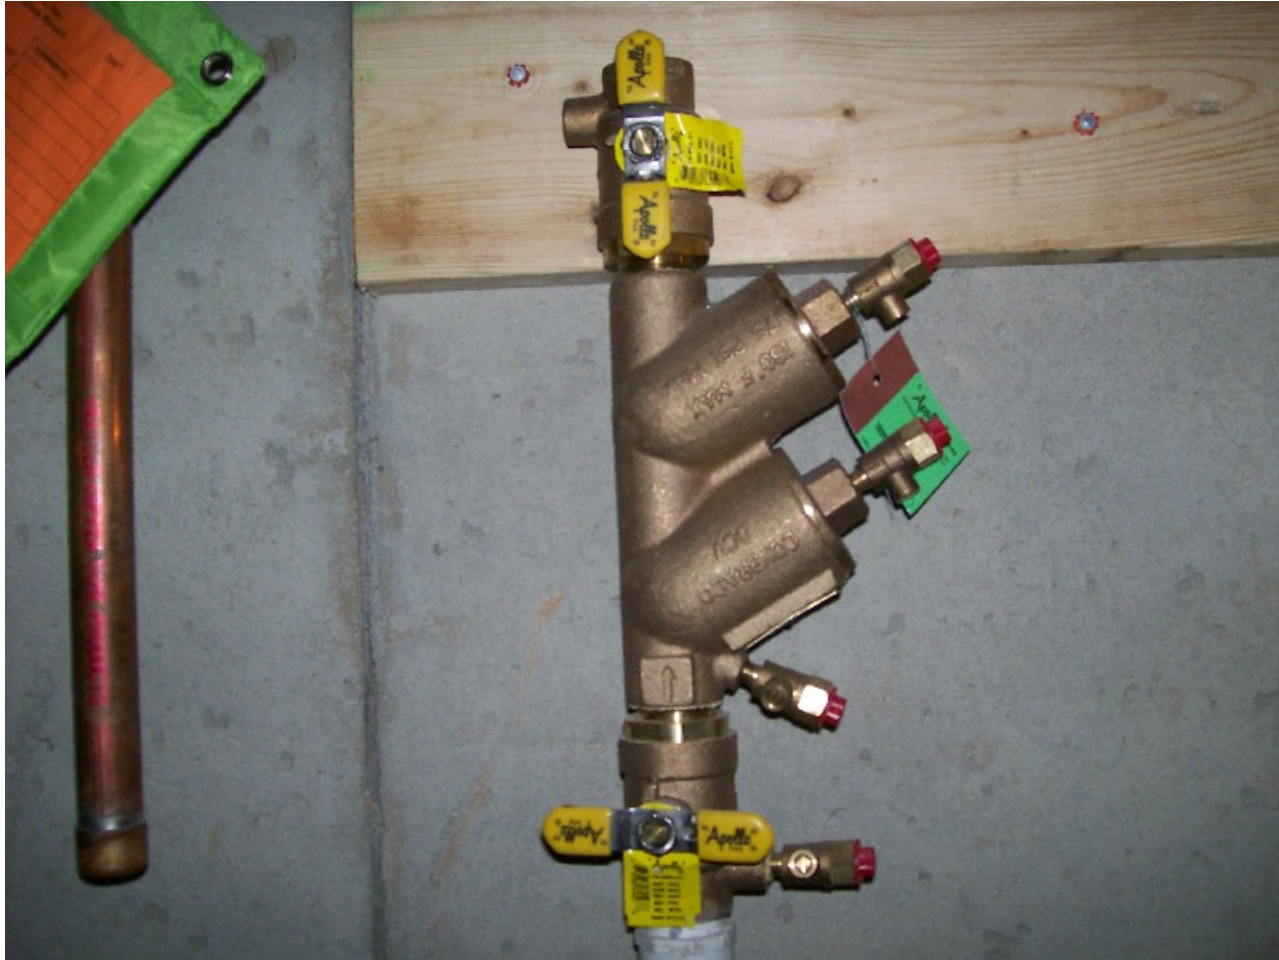

Apollo 1015 Backflow



BFP without Lockouts and Tag



Use Boots and Heavy Duty Zip Ties



Sprinkler Information Packet Supplied by FM Office



Warning Tag and...



Sprinkler Packet Attached



Tag for System Must Be Present



Warning Tag



WARNING

DO NOT TAMPER WITH THESE
DEVICES UNLESS YOU ARE A
LICENSED CONTRACTOR.

These valves must remain locked in
the open position at all times.

WARNING

IF there is a pump installed, it must be
replaced with a similar like model and
horsepower to ensure a properly
working fire sprinkler system.

Pump Make _____

Pump Model _____

Pump Horsepower _____

Date of Installation _____

Controller for pump _____

Schedule Testing Annually with your
licensed sprinkler contractor.


Locks are Not Allowed/Use Heavy Duty Zip Ties



WSSC Will NOT Replace Locks



Other Acceptable Supervision

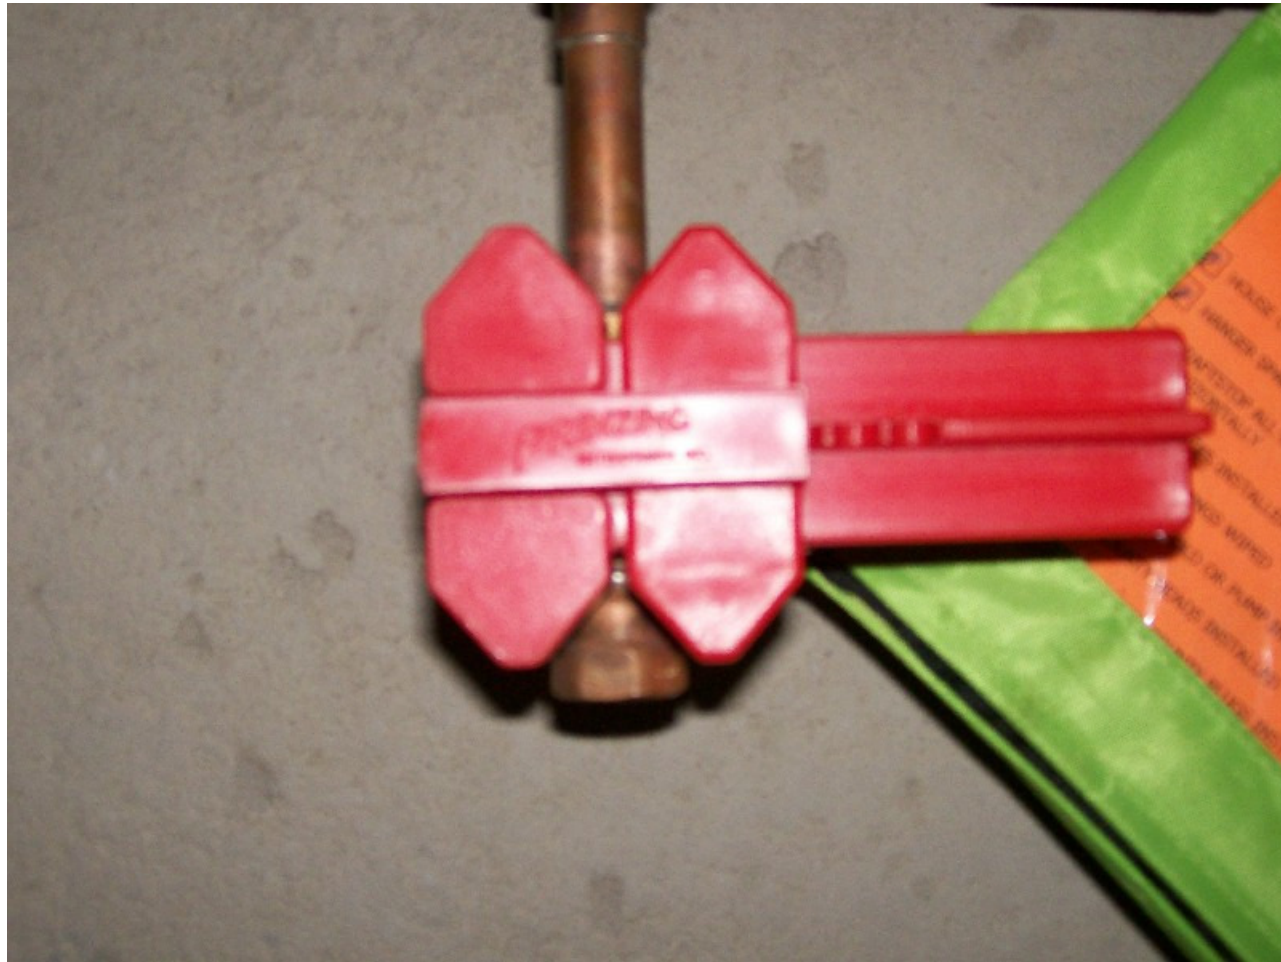

...with lockout and tag.



Other Acceptable Supervision



Up to AHJ



Video on How to Install



Locks Do Not Work

